

OFFICE OF CIVIL SURGEON,
JALANDHAR


CERTIFICATE

No: 1159

Date: 27-12-2022

TO WHOM IT MAY CONCERN

Certified that the team of Health Inspectors inspected the "Innocent Hearts School, Nurpur, Pathankot Road, Jalandhar". On the basis of report given by team, it is certified that the hygienic conditions of the "Innocent Hearts School, Nurpur, Pathankot Road, Jalandhar" is good at present.


Civil Surgeon, Jalandhar.
Civil Surgeon, Jalandhar

Date: 27-12-2022

Place: Jalandhar

27/12/23

MUNICIPAL CORPORATION JALANDHAR

WATER TESTING LABORATORY

(WATER ANALYSIS REPORT)

REF. NO:- 59

SAMPLE PROVIDED BY:- Innocent Health School

REF. DT. 27/1/23 SAMPLE COLLECTED:-


Pathankot Road, Narpuh - Jalandhar

SR. NO.	TEST	REQUIRED LIMIT IS10500	SAMPLE (1)	SAMPLE (2)	SAMPLE (3)	SAMPLE (4)
1	COLOUR	5 HAZEN	Colourless			
2	ODOUR	UNOBJECTIONABLE	Odourless			
3	TASTE	AGREEABLE	Noiseless			
4	PH	6.5-8.5	6.6			
5	TOTAL HARDNESS AS CaCO ₃	300 mg/l	23			
6	DISSOLVED SOLIDS(TDS)	500 ppm	53			
7	ALKALINITY	200 mg/l	20			
8	CALCIUM AS Ca ⁺⁺	75 mg/l	12.0			
9	IRON	0.3 mg/l	Nd			
10	CHLORIDE	250 mg/l	24			
11	SULPHATE	150 mg/l	-			
12	NITRATES	4.5 mg/l	Nd			
13	RESIDUAL CHLORINE	0.2 mg/l	Nd			
14	FLUORIDE	1.0 mg/l	0.1			
15	LEAD	0.05 mg/l	-			
	BACTERIAL TEST					
	TOTAL COLIFORM COUNT		/			
	BY MPN METHOD PER 100ML		Nd			
	TOTAL E-COLI COUNT		/			
	BY MPN METHOD PER 100ML		/			
	TOTAL E-COLI COUNT		/			
	BY COLONY COUNT METHOD		/			

REMARKS:

The provided water sample found satisfactory as per the applied tests.

Devi Singh Analyst
Municipal Corporation
Jalandhar 30/1/23

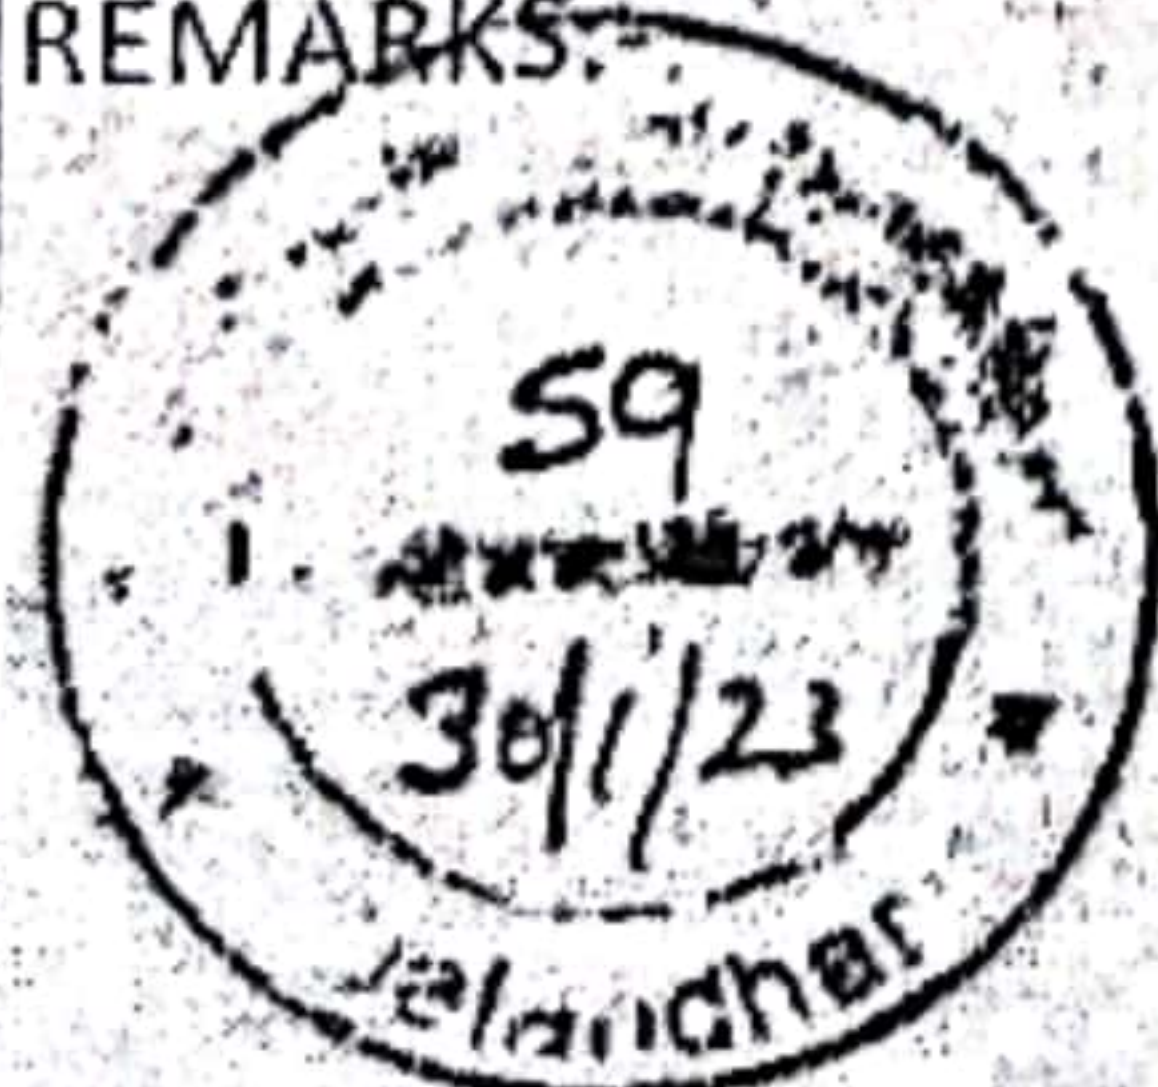

30/1/23